


Installtion Instructions
TRACK PLUS-Starter Set









	EN To secure safety, a qualified electrician is required to install/remove the luminaire.	IT Per garantire massima sicurezza, far eseguire il lavoro di installazione/rimozione della lampada da un elettricista specializzato.
	DE Aus Sicherheitsgründen ist der Einbau/Ausbau dieser Leuchte nur durch eine Elektrofachkraft vorzunehmen.	ES Para asegurar la seguridad, se requiere un electricista cualificado para instalar / retirar la luminaria.
	FR Afin de garantir la sécurité du luminaire, celui-ci doit être installé ou retiré par un électricien qualifié.	PT Para a sua segurança, um eletricitista qualificado deve atuar na instalação/remoção da luminária.
	EN The luminaire is used exclusively for lighting and is to be installed/ removed in accordance with IEEE regulations and installation instructions.	IT La lampada va utilizzata esclusivamente per funzioni di illuminazione e va installata/rimossa ai sensi dei regolamenti IEEE e delle istruzioni di installazione.
	DE Die Leuchte ist ausschliesslich für Beleuchtungszwecke vorgesehen. Der Einbau/Ausbau hat gemäss den einschlägigen nationalen Richtlinien und Vorschriften sowie den beiliegenden Montageanweisungen zu erfolgen.	ES La luminaria se utiliza exclusivamente para iluminar y tiene que instalarse / retirarse de acuerdo con las instrucciones de instalación y las normativas de la IEEE.
	FR Le luminaire ne doit être utilisé qu'à des fins d'éclairage et doit être installé ou retiré conformément aux réglementations relatives aux DEEE et aux instructions d'installation.	PT A luminária é utilizada exclusivamente para iluminação e deve ser instalada/removida de acordo Com as regulações e instruções de instalações IEEE.

General Safety Instructions

- A warning that it is the user's responsibility to ensure electrical, mechanical and thermal compatibility between the track system and luminaires attached to it**
- Installation and commissioning may only be carried out by authorized specialists.
 - Recommended use: in dry rooms;
 - The track is forbidden to use the track light without an end cap and open connector. bare track ends must be covered with an end cap.
 - the track is suitable for wall/ceiling mounted, but not suitable for non-horizontal mounting.
 - The components and luminaires of this system may not be combined with track systems of safety class I or II or with any other track system.
 - Safety class III
 - Operated with safety extra-low voltage.
 - Load limit is 2kg.
 - The specified admissible mechanical load of the tracks is the total load of a complete system.
 - The feed-in may only be connected to a SELV supply which is specified to operate components of the safety class III.
 - Caution: To reduce the risk of overheating and fire do not bridge conductors.
 - Controller shall only be provided by a SELV source.

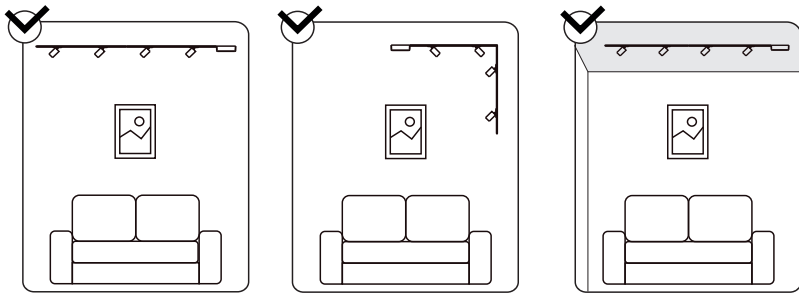

LINE20V-ON-OFF-Wiring Diagram

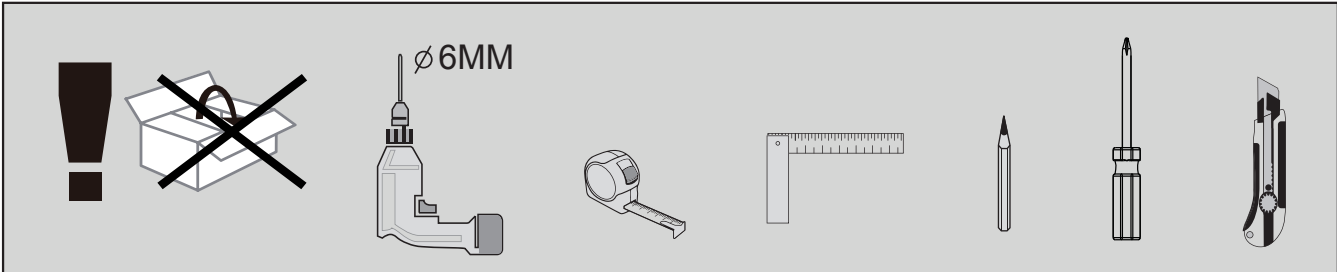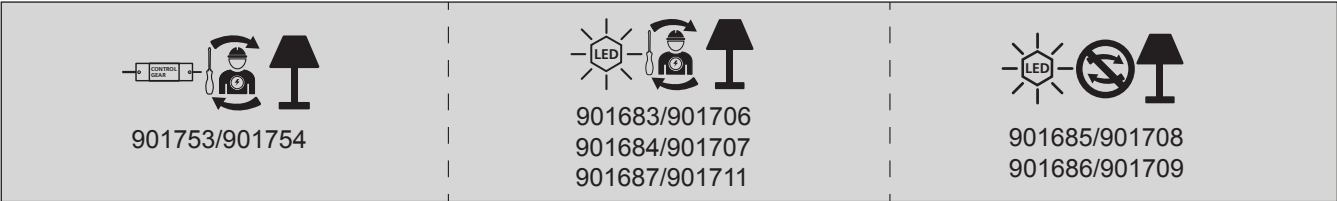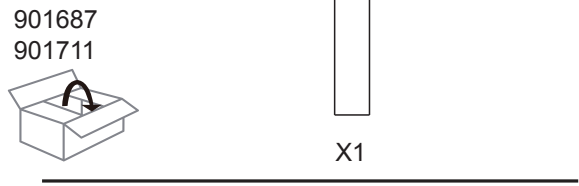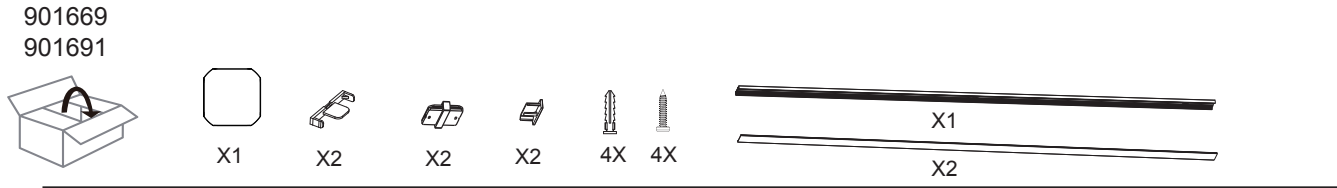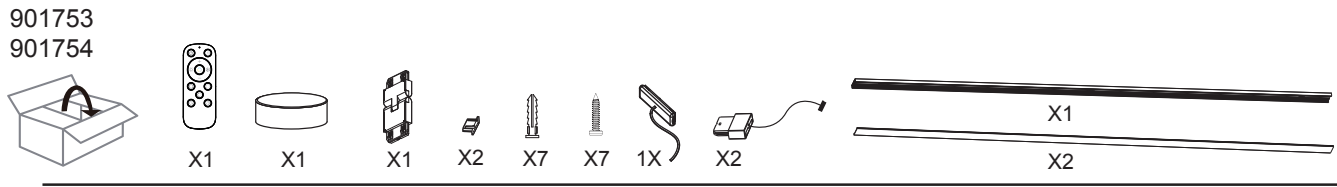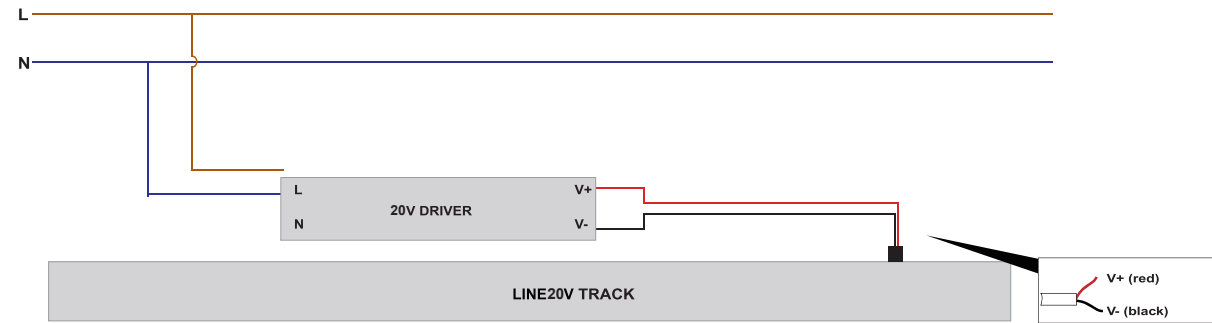

A Power supply installtion I

A1 A1.1

A1.2

A2

A3

A4

A5

A6

A7

A4.2





B Deported power supply installation II

B1 B1.1


B1.2

B2

B3

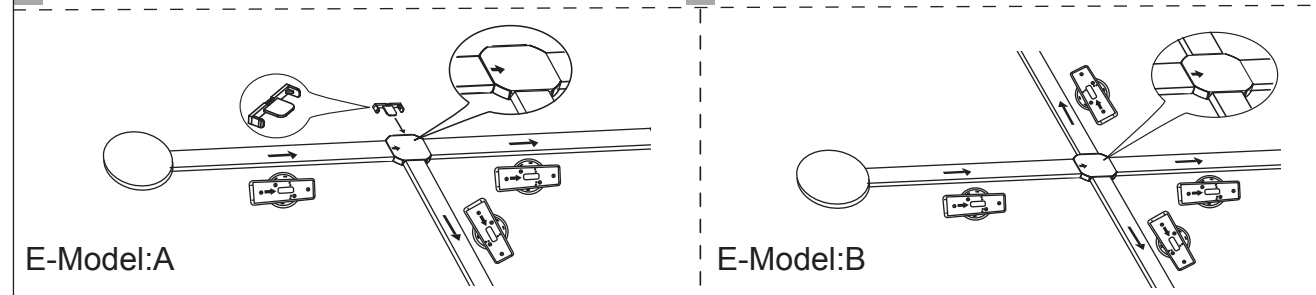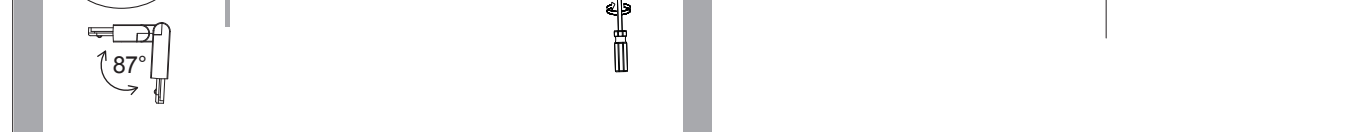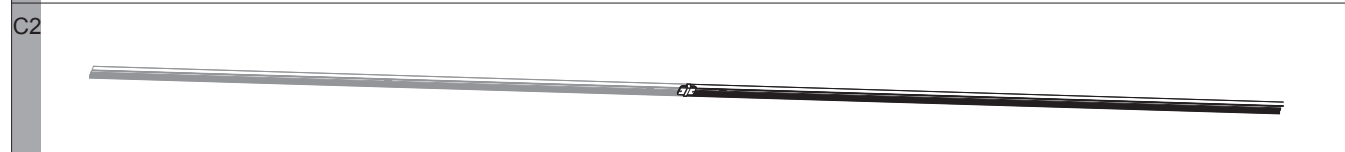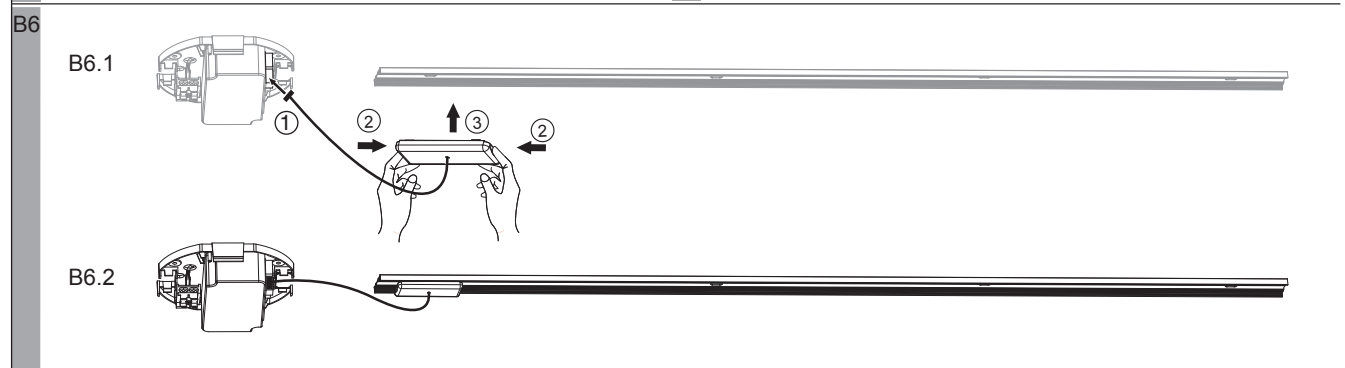

Luminaire installation

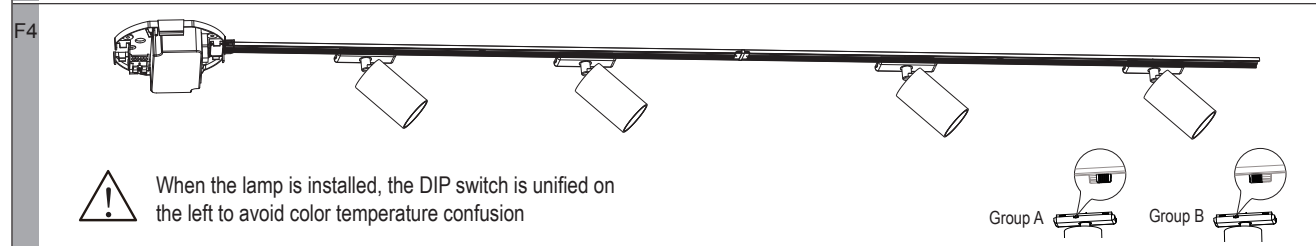

901687		
901711	901683	901684
	901706	901707

Cover mounting

